

Air distribution and temperature control in classrooms

Jarek Kurnitski and Minna Aalto

Helsinki University of Technology, Finland

Corresponding email: jarek.kurnitski@tkk.fi

SUMMARY

Air distribution solutions for classrooms aiming to lower air velocities and good temperature control are studied by measurements in 6 schools and temperature simulations. Air velocity measurements showed good performance of duct and ceiling diffusers which provided maximum velocities less than 0.2 m/s and can be highly recommended for classrooms. The wall diffusers were clearly not suitable for classrooms due to high velocities up to 0.43 m/s. Displacement ventilation diffusers were very sensitive to supply air temperature, as with the temperature difference of 3 °C velocities up to 0.28 m/s were measured. Room temperature measurement results showed a typical problem with temperature control as at the end of the heating season the temperatures up to 25 °C were measured. The parametric simulations showed that high supply air flow rates up to 10 L/s per person and cool supply air down to 14–15 °C were needed for room temperature control.

INTRODUCTION

Many studies have shown that poor indoor environmental quality (IEQ) in office buildings can reduce the performance of office work by adults [1,2]. While it is well documented that IEQ in schools is both inadequate and frequently much worse than in office buildings [3], there is little direct evidence that classroom performance is being negatively affected [4].

Experimental interventions [5,6] show that increasing the outdoor air supply rate and reducing moderately elevated classroom temperatures significantly improved the classroom performance of many tasks, mainly in terms of how quickly each pupil worked (speed). In these experiments the room temperature was reduced from 25°C to 20°C and the outdoor air supply rate was increased from 5.2 to 9.6 L/s per person. Thus the results suggest that higher ventilation rates up to 10 L/s per person as well as more strict temperature control than commonly used can be recommended for classrooms. This means new challenges in the design of classroom ventilation and temperature control. High airflow rates and low supply air temperatures, which are needed for temperature control, may easily cause draft. This may be avoided by careful selection of air distribution solutions and terminal devices.

In this study, air distribution solutions for classrooms aiming to lower air velocities and good room temperature control are studied by measurements in classrooms and temperature simulations. Performance of wall, ceiling, duct and displacement diffusers is compared at ventilation rates up to 340 L/s per classroom and supply air temperatures up to 6°C lower than room temperature. Based on the results, design guidelines of air distribution and temperature control solutions leading to healthy and productive indoor environment in classrooms can be given.

METHODS

Air velocity, room temperature and CO₂ measurements were done in 6 schools. All schools were either relatively new buildings or renovated buildings, all having modern mechanical supply and exhaust ventilation systems with ventilation rates, corresponding at least to Finnish minimum code requirements for ventilation of new buildings.



a)



b)

Figure 1. School A with wall diffusers, a) and B with ceiling diffusers, b).




a)



b)

Figure 2. School C, a) and D, b) with duct diffusers.

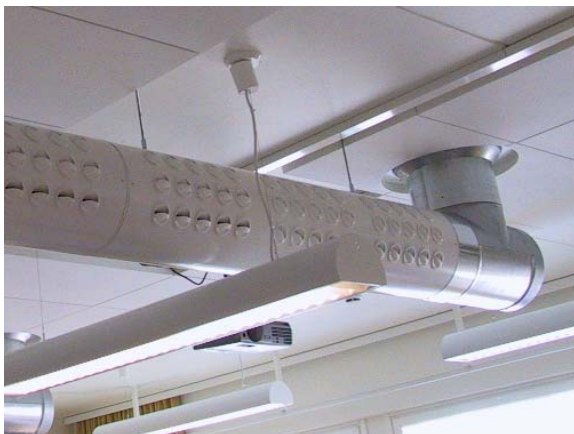

a)



b)

Figure 3. School E with duct diffusers, a) and F with displacement diffusers, b).

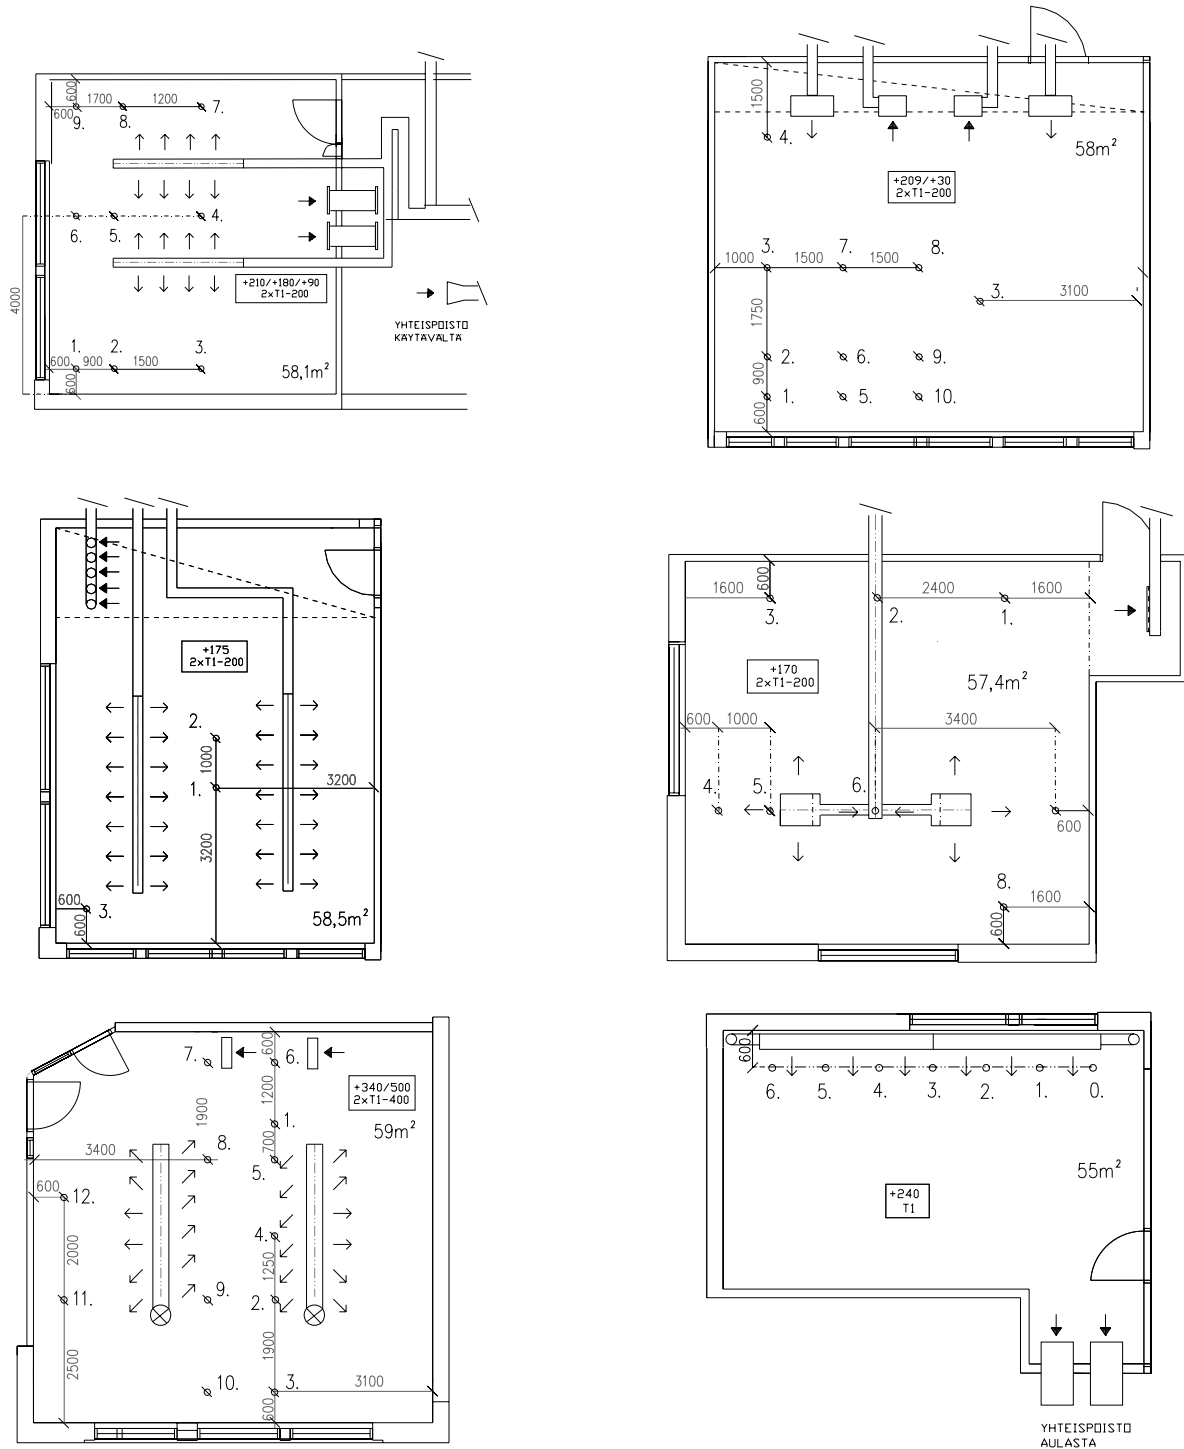


Figure 4. Air velocity measurement points in the classrooms (the classrooms are in the same order as in Figures 1–3).

School A had air distribution by ceiling diffusers (two diffusers per classroom) and school B by wall diffusers (two diffusers per classroom), which represents a low cost solution most commonly used, Figure 1. In three schools (C, D, E) duct diffusers (two ducts per classroom) and in school F displacement ventilation diffusers were used, Figures 2 and 3.

In schools from *A* to *D*, temperature and CO₂ concentrations were measured during a one week period in May 2006 from three classrooms in each school. Air velocity measurements were done in one classroom. In *E* velocity was measured in two classrooms and supply air temperature was set by 4 to 6 °C below the room temperature. In *F* data from previous measurements [7] was used to compare the performance of displacement ventilation to mixing ventilation. Air velocity measurement points were selected with smoke tests, so that the highest velocities could be measured. The measurement points are shown in Figure 4.

Both constant air volume (CAV) and demand controlled (DCV) ventilation systems with constant or controlled supply air temperature were used in schools. Differences between DCV and CAV systems and supply air temperature control options were studied with temperature and ventilation simulations for typical classrooms with a varying heat load.

RESULTS

Measurement results in the schools

Supply air flow rates measured from terminal devices and typical occupancy in the classrooms is shown in Table 1. *E* was a new school having almost doubled supply airflow rate (design value of 12 l/s per person, 340 l/s in total) and also other target values of the highest indoor climate class. Schools *A* and *B* had CO₂- and CO₂&temperature controlled ventilation with 3 and 2 airflow steps respectively. In other schools constant air volume systems were used. *A* to *D* had a constant supply air temperature and in *E* and *F* supply air temperature was controlled according to exhaust air temperature.

Table 1. Measured supply air flow rates and typical occupancy in the classrooms

School	Occupancy, pers.	Supply air flow rate, L/s per pers.	Supply air flow rate, L/s	Design supply air flow rate, L/s
A	20	7	138	210/150/90
B	27	7	186	210/30
C	22	6	136	175
D	20-25	6.8-8.2	168	170
E			348	340
F			180	180

Outdoor temperature during the measurement week was typical spring weather, between 9...12 °C. This represents the end of heating season and the results are compared to heating season target values. Room temperature and CO₂ results from classrooms where air velocity measurements were done are shown in Figure 5. Results are given only from the school time period which is from 8.00 to 15.00 on week-days. Temperatures measured from other classrooms in schools *A* to *D* (measured with loggers with a lower resolution compared to Figure 5) and previously measured temperatures from *G* are shown in Figure 6.

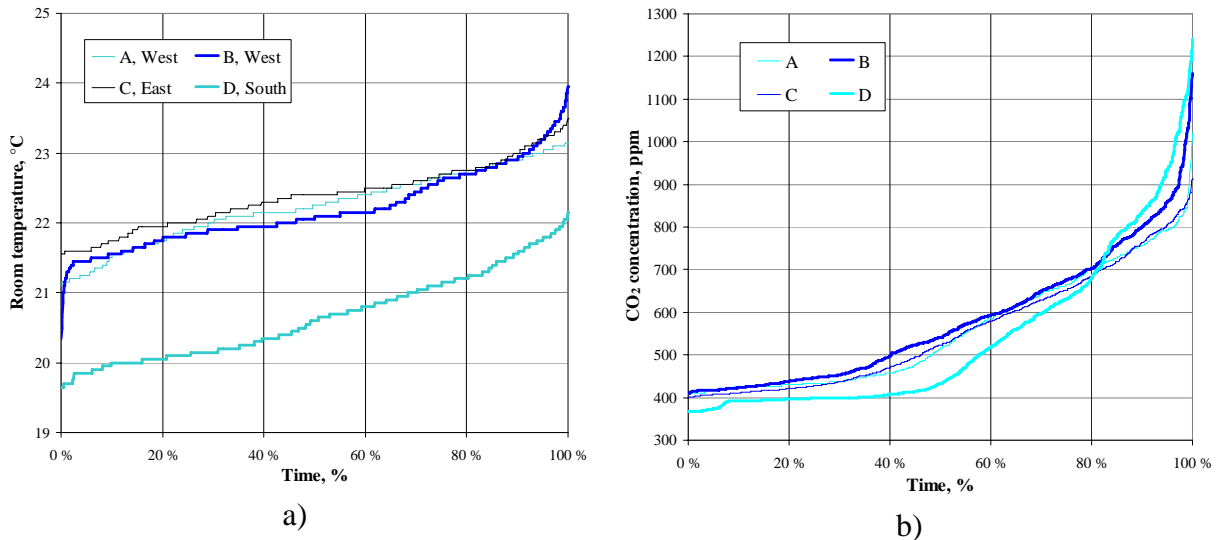


Figure 5. Duration curves of room temperature, a) and CO₂, b); data from 8.00 to 15.00 on week-days

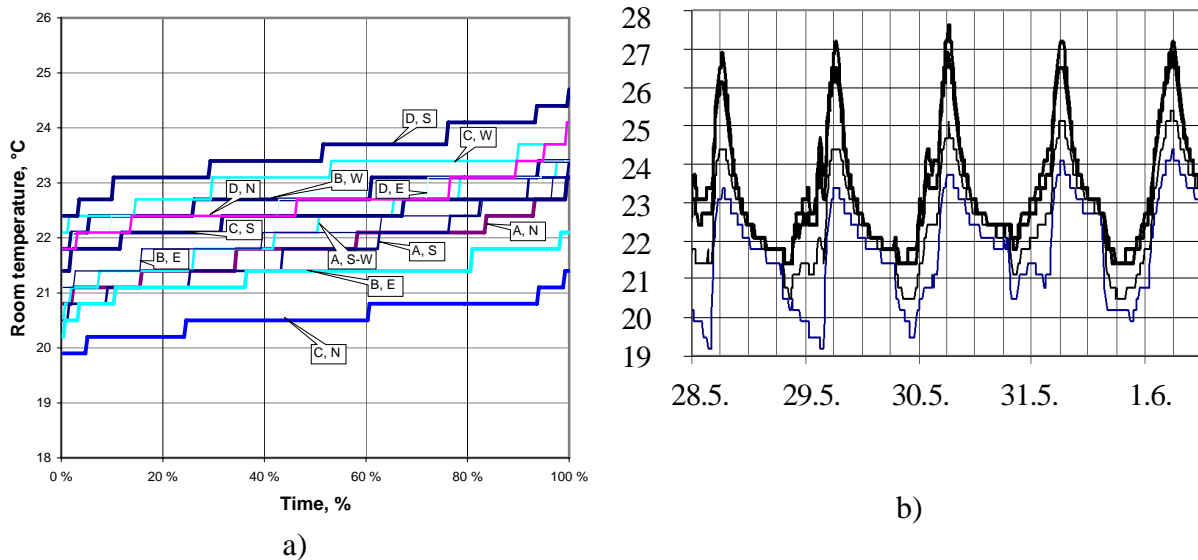


Figure 6. Duration curves of temperatures in other classrooms in A to D from 8.00 to 15.00 on week-days, a) and temperatures from E during 28.5-1.6.2003, b)

Air velocity measurement results from the occupied zone are shown in Table 2. In A to D supply air temperature was not adjusted, but just measured. In E and F the effect of supply air temperature on draft was studied by changing the temperature of supply air and repeating the velocity measurements.

In F with displacement diffusers the results were very sensitive to the temperature difference. Air velocities at 0.1 m height, 0.6 m from diffusers, were 0.14...0.18 m/s when supply air temperature was equal to room temperature. Measurements with the temperature difference of 3 °C gave higher velocities, as shown in Table 2.

Table 2. Air velocity measurement results. Measurement locations are shown in Figure 4.

Meas. point	Air Velocity, m/s			Operative temperature, °C	Supply air temperature, °C	DT, room - supply air temperature, °C
	Measurement height					
	0.1m	1.10m	1.80m			
A, duct diffusers, 138 L/s						
1	0.21	0.05	0.05	24.6	20.4	4.2
2	0.25	0.06	0.13	24.7	20.4	4.3
3	0.15	0.03	0.03	24.8	20.4	4.4
4	0.09	0.06	0.06	25.0	20.4	4.6
5	0.01	0.18	0.16	25.1	20.4	4.7
6	0.03	0.13	0.20	24.9	20.4	4.5
7	0.09	0.02	0.04	24.9	20.4	4.5
8	0.16	0.03	0.04	24.8	20.4	4.4
9	0.18	0.29	0.08	24.6	20.4	4.2
			Average, °C	24.8	Average, °C	4.4
B, wall diffusers, 186 L/s						
1	0.18	0.43	0.15	22.6	20.4	2.2
2	0.30	0.09	0.06	22.7	20.4	2.3
3	0.25	0.30	0.07	22.8	20.4	2.4
4	0.16	0.05	0.05	22.8	20.4	2.4
5	0.06	0.38	0.08	23.0	20.4	2.6
6	0.17	0.17	0.11	23.0	20.4	2.6
7	0.19	0.15	0.14	23.0	20.4	2.6
8	0.12	0.14	0.14	23.3	20.4	2.9
9	0.15	0.2	0.1	23.3	20.4	2.9
10	0.08	0.14	0.14	23.3	20.4	2.9
			Average, °C	23.0	Average, °C	2.6
C, duct diffusers, 136 L/s						
1	0.10	0.07	0.16	22.6	19.8	2.9
2	0.05	0.06	0.05	22.2	19.8	2.5
3	0.02	0.04	0.06	22.1	19.8	2.4
			Average, °C	22.3	Average, °C	2.6
D, ceiling diffusers, 168 L/s						
1	0.02	0.03	0.03	20.6	19.4	1.2
2	0.06	0.03	0.03	20.7	19.4	1.3
3	0.03	0.02	0.02	20.8	19.4	1.4
4	0.03	0.05	0.14	21.0	19.4	1.6
5	0.04	0.03	0.03	21.0	19.4	1.6
6	0.02	0.05	0.04	20.9	19.4	1.5
7	0.11	0.06	0.06	20.7	19.4	1.3
8	0.08	0.09	0.07	20.7	19.4	1.3
			Average, °C	20.8	Average, °C	1.4
E, duct diffusers 348 l/s						
2	0.11	0.09	0.09	21.70	17.50	4.2
3	0.17	0.09	0.09	21.70	17.35	4.4
4	0.09	0.07	0.08	21.60	17.20	4.4
5	0.15	0.10	0.06	21.50	17.20	4.3
6	0.08	0.09	0.12	21.40	17.15	4.3
7	0.07	0.11	0.13	21.40	17.30	4.1
8	0.16	0.11	0.11	21.50	17.35	4.2
9	0.06	0.05	0.04	22.00	17.35	4.7
10	0.05	0.04	0.05	22.20	17.40	4.8
11	0.08	0.06	0.07	22.00	17.85	4.2
12	0.10	0.08	0.08	21.80	16.75	5.1
			Average, °C	21.7	Average, °C	4.4
E, duct diffusers 348 l/s						
3	0.08	0.05	0.03	22.4	16.1	6.3
6	0.06	0.11	0.14	21.5	16.3	5.3
7	0.10	0.14	0.19	21.4	16.4	5.1
10	0.07	0.04	0.06	22.3	16.1	6.2
			Average, °C	21.9	Average, °C	5.7
F, displacement diffusers 180 l/s						
0	0.22					3
1	0.18					3
2	0.05					3
3	0.22					3
4	0.28					3
5	0.19					3
6	0.15					3

Room temperature simulations

Temperature control and ventilation rate options were simulated with IDA-ICE software for CAV and DCV systems without mechanical cooling in order to find good solutions for classroom ventilation and temperature control. The time period was chosen according to the typical use of schools: heating season from Jan 2 to May 14 and Oct 1 to Dec 23, and summer season from May 15 to May 31 and Aug 15 to Sept 30. Two classrooms were simulated as this configuration gave the same results as the configuration with six classrooms, Figure 7. A classroom with 30 students faced south and another with 20 students north. The occupancy profile used and the control curve of supply air temperature determined in the simulations are shown in Figure 8. For the south classroom, solar protection glasses were used.

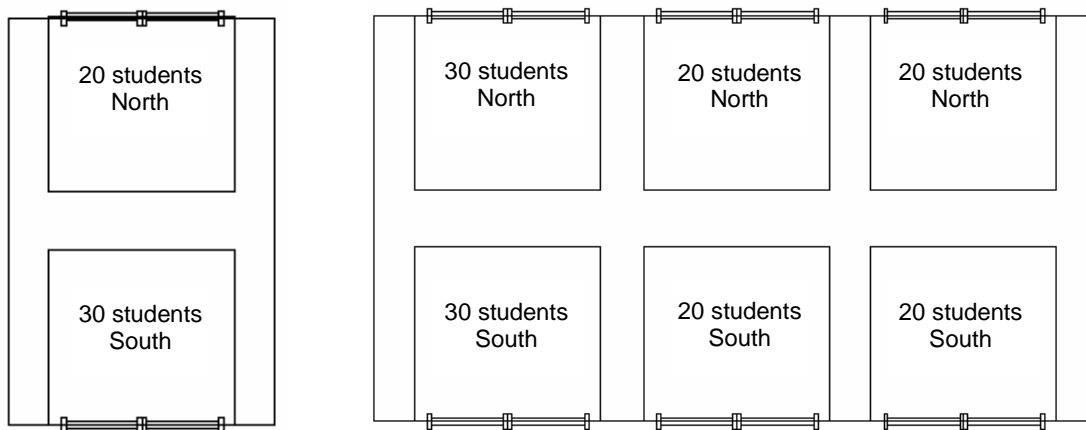


Figure 7. The configuration of 2-classrooms used in the simulations, a) The configuration of 6-classrooms used for the testing of 2-classroom configuration, b)

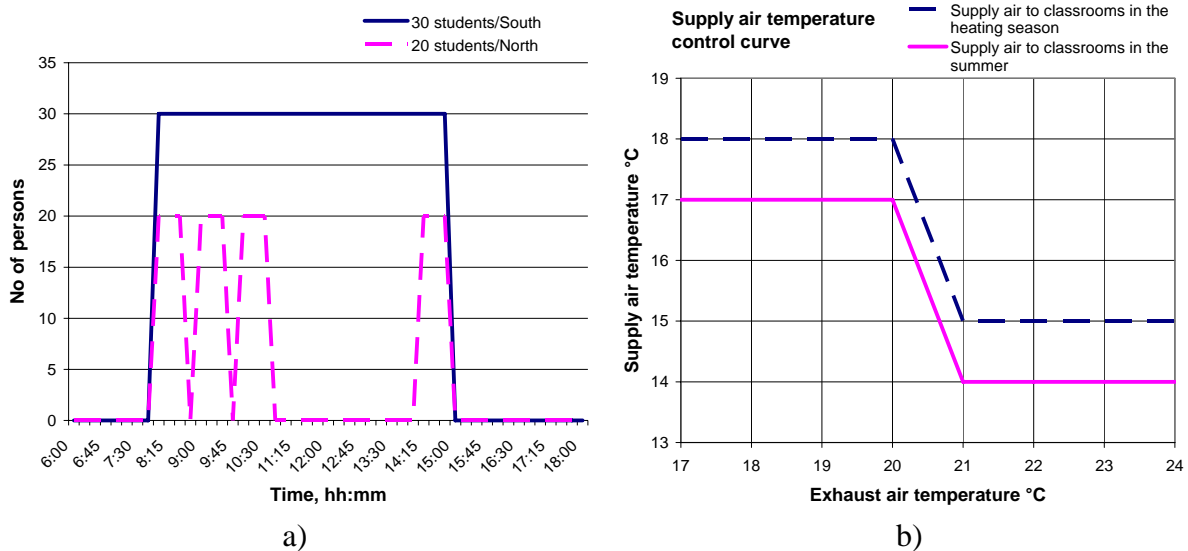


Figure 8. The occupancy profile of students, a) and determined supply air temperature control curve, b) (supply air temperature values can only be achieved if outdoor temperature is lower than supply air temperature, as there is no mechanical cooling in the system)

Two ventilation rates, 6 L/s per person, 180 L/s per classroom in total, and 10 L/s per person, 300 L/s per classroom in total, were simulated. For both rates CAV system and DCV system with CO₂ and temperature control was simulated. DCV system had two air flow steps, 100 %

and 40% of total airflow. The results are shown in Figure 9 for the summer period and in Figure 10 for the heating season. With night time ventilative cooling the summer period temperatures were possible to lower by about 1 °C from values shown in Figure 9.

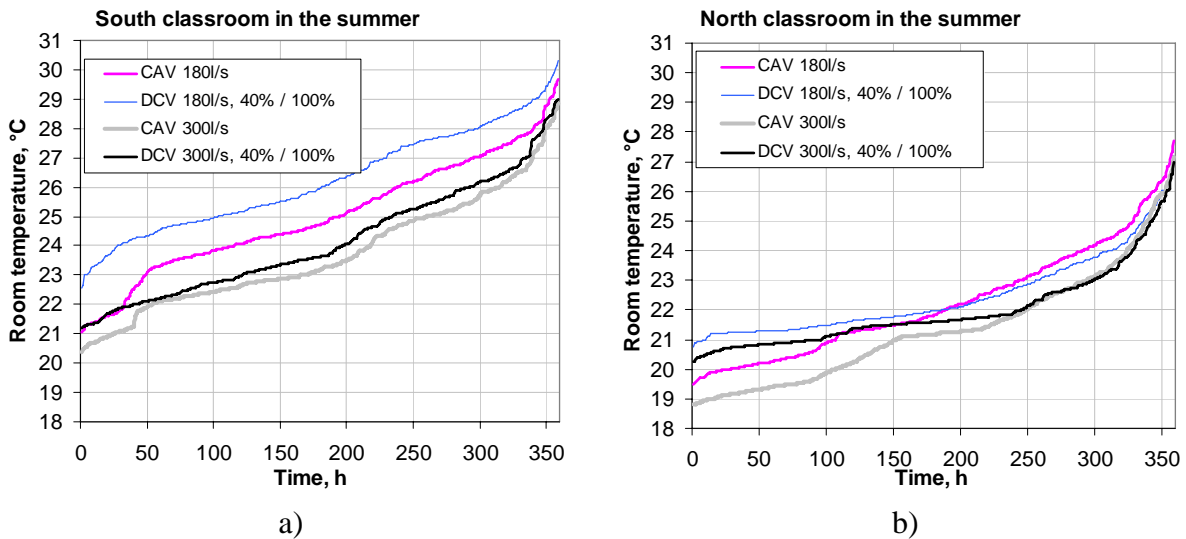


Figure 9. Summer period room temperature duration curves in the south classroom, a) and in the north classroom, b)

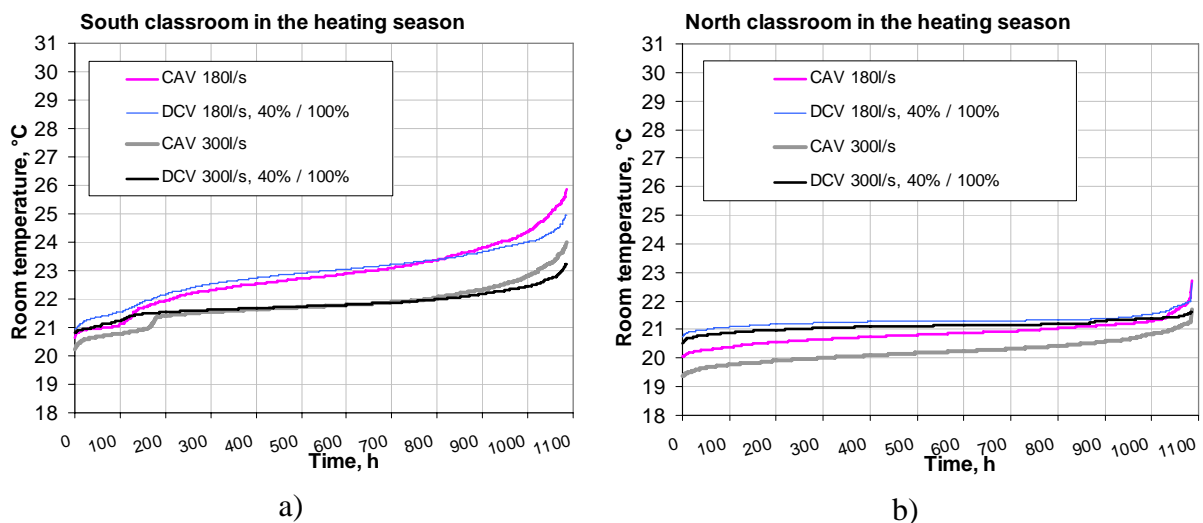


Figure 10. Heating season room temperature duration curves in the south classroom, a) and in the north classroom, b)

DISCUSSION

Measured supply air flow rates were significantly lower than design values in three schools out of six. Due to relatively low occupancy the airflows per person were still sufficient, 6 L/s per person or more in all schools and CO₂ concentrations were less than 1200 ppm. Room temperature measurement results show a typical problem with temperature control as at the end of the heating season the temperatures up to 25 °C were measured. Simulated results show that this problem can be avoided without mechanical cooling if high enough ventilation rates and cool supply air is used. In the majority of the schools measured, ventilation rates were too low and supply air too warm for effective control of the room temperature.

Air velocity measurements showed remarkable differences between air distribution schemes. Duct and ceiling diffusers showed good performance with a maximum velocity less than 0.2 m/s and can be highly recommended for classrooms. The duct diffuser in A without nozzles (just a perforated duct) showed worse performance with a maximum velocity of 0.29 m/s. The wall diffusers were clearly not suitable for classrooms due to high velocities up to 0.43 m/s. Displacement ventilation diffusers were very sensitive to supply air temperature, as a temperature difference of 3 °C caused velocities up to 0.28 m/s.

The parametric simulations showed the effect of high internal gains: high supply air flow rates up to 10 L/s per person and cool supply air down to 14–15 °C was needed for room temperature control. However, mechanical cooling was not needed in the classrooms as schools are normally not used during summer holidays. DCV ventilation showed better performance in terms of thermal comfort when higher simulated airflow rate of 300 L/s per classroom was used. At lower airflow rate of 180 L/s the classrooms were less overheated with CAV ventilation. It was shown that a DCV system supplying 10 l/s per student and 300 L/s per classroom combined with night-time ventilative cooling ensured good temperature control in fully occupied as well as partly occupied classrooms. A similarly sized CAV system cooled down classrooms with low occupancy, thus, demanded additional heating of the supply air in classrooms. Air flow rate of the lower indoor climate category, 6 l/s per student and 180 L/s per classroom, resulted still tolerable but significantly higher temperatures, often above 23 °C in the heating season.

ACKNOWLEDGEMENT

This research was supported by the Finnish National Technology Agency Tekes and cities of Espoo, Helsinki and Vihti.

REFERENCES

1. Seppänen O, Fisk Wand Lei Q (2006) "Ventilation and performance in office work", *Indoor Air*, 16: 28-36.
2. Wyon DP and Wargocki P (2006) "Indoor air quality effects on office work", In: Croome, D. (ed.) *Creating a Productive Environment*, (in press).
3. Angell WJ, Daisey J (1997) "Building factors associated with school indoor air quality problems: A perspective" *Proceedings of Healthy Buildings/IAQ'97*, Washington DC, Vol. 1, 143-148. Virginia Polytechnic Institute and State University.
4. Mendell MJ and Heath GA (2005) "Do indoor pollutants and thermal conditions in schools influence student performance? A critical review of the literature", *Indoor Air*, 15: 27-52.
5. Wargocki P and Wyon DP (2006) "Effects of HVAC On Student Performance", *ASHRAE Journal*, Vol. 48, Oct. 2006.
6. Wargocki P, Wyon DP, Matysiak B et al. (2005a) "The effects of classroom air temperature and outdoor air supply rate on the performance of schoolwork by children", In: *Proceedings of Indoor Air 2005*, Beijing, China, Vol. I(1), pp. 368-372.
7. Palonen J (2003) "Indoor climate measurements in Poikkilaakso school building" (in Finnish), Helsinki University of Technology, HVAC-laboratory.